


**MOUNT  
THIS END UP  
(SEE NOTE 3)**

# ENCLOSED CHARGER CUSTOMER INSTALLATION

REVISIONS				
DCN	REV	DESCRIPTION	DATE	APPROVED
--	--	See sheet 1.	--	--

J1939 ADDRESS SELECT JUMPERS  
 J1939 OR MODBUS  
 REMOTE TEMPERATURE SENSOR CONNECTIONS (OPTIONAL)  
 ALARM CONNECTIONS  
 ALARM CONNECTIONS (OPTIONAL)

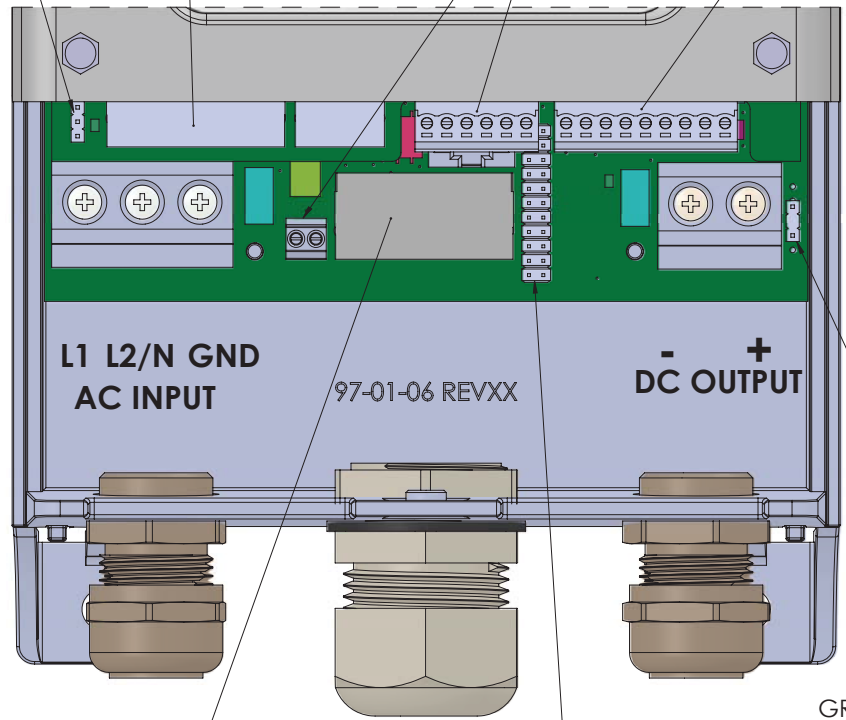

AC WIRING ENTRY  
 CONTROL WIRING ENTRY  
 DC WIRING ENTRY

**LOWER COVER  
REMOVED**

USER COMMUNICATIONS (MODEL DEPENDENT)  
 ACCESSORY BOARD (OPTIONAL)  
 CUSTOMER SUPPLIED CONDUIT OR CORD BUSHINGS

CHARGER OUTPUT JUMPER SETTINGS

GROUND FAULT JUMPER

- NOTES:
1. INSTALL ENCLOSED CHARGER USING CUSTOMER SUPPLIED 1/4 MAX MOUNTING HARDWARE.
  2. PROVIDE ADEQUATE CLEARANCE AROUND THE CHARGER FOR VENTILATION. MINIMUM CLEARANCES ARE: 0.5 INCHES FOR EACH SIDE, 4 INCHES AT BOTTOM SURFACE AND 6 INCHES ABOVE THE TOP SURFACE.
  3. CHARGER MUST BE MOUNTED VERTICALLY FOR ADEQUATE VENTILATION.

<p><b>SENS</b> STORED ENERGY SYSTEMS</p> <p>PROPRIETARY AND CONFIDENTIAL</p> <p>THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF STORED ENERGY SYSTEMS, LLC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF STORED ENERGY SYSTEMS, LLC, IS PROHIBITED.</p>	UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN INCHES DEFAULT TOLERANCES:	NAME JWF	DATE 2/7/2014	DESCRIPTION 2DCAD, MG2, ENCLOSED, STANDARD
	DO NOT SCALE DRAWING	THIRD ANGLE PROJECTION 		SIZE C
		DOCUMENT NUMBER 2DCAD-MG2-STD-ENC		REV C
				SHEET 2 OF 2